



We work with others to protect the health of the people of Washington State by ensuring safe and reliable drinking water.



WASHINGTON UPDATE

REGION 10 AWOP- JUN 2020

Impact of COVID19



On Hold

Lab skills-measuring chlorine residual

Membrane LRV verification

Sanitary surveys

Washington Optimization Network



Done Instead

COVID19 Guidance

- WTP Staffing Continuity
- WTP SOPs
- WTP Supply Chain Continuity
- Building Plumbing (2)

Alum Dose Poster

Cold Weather Operations


DE Optimization

HABs Guidance (draft)

Staff furloughs


WA State Rapid Rate Plant Performance Trends

95th Percentile Max. Daily Turbidity - NTU

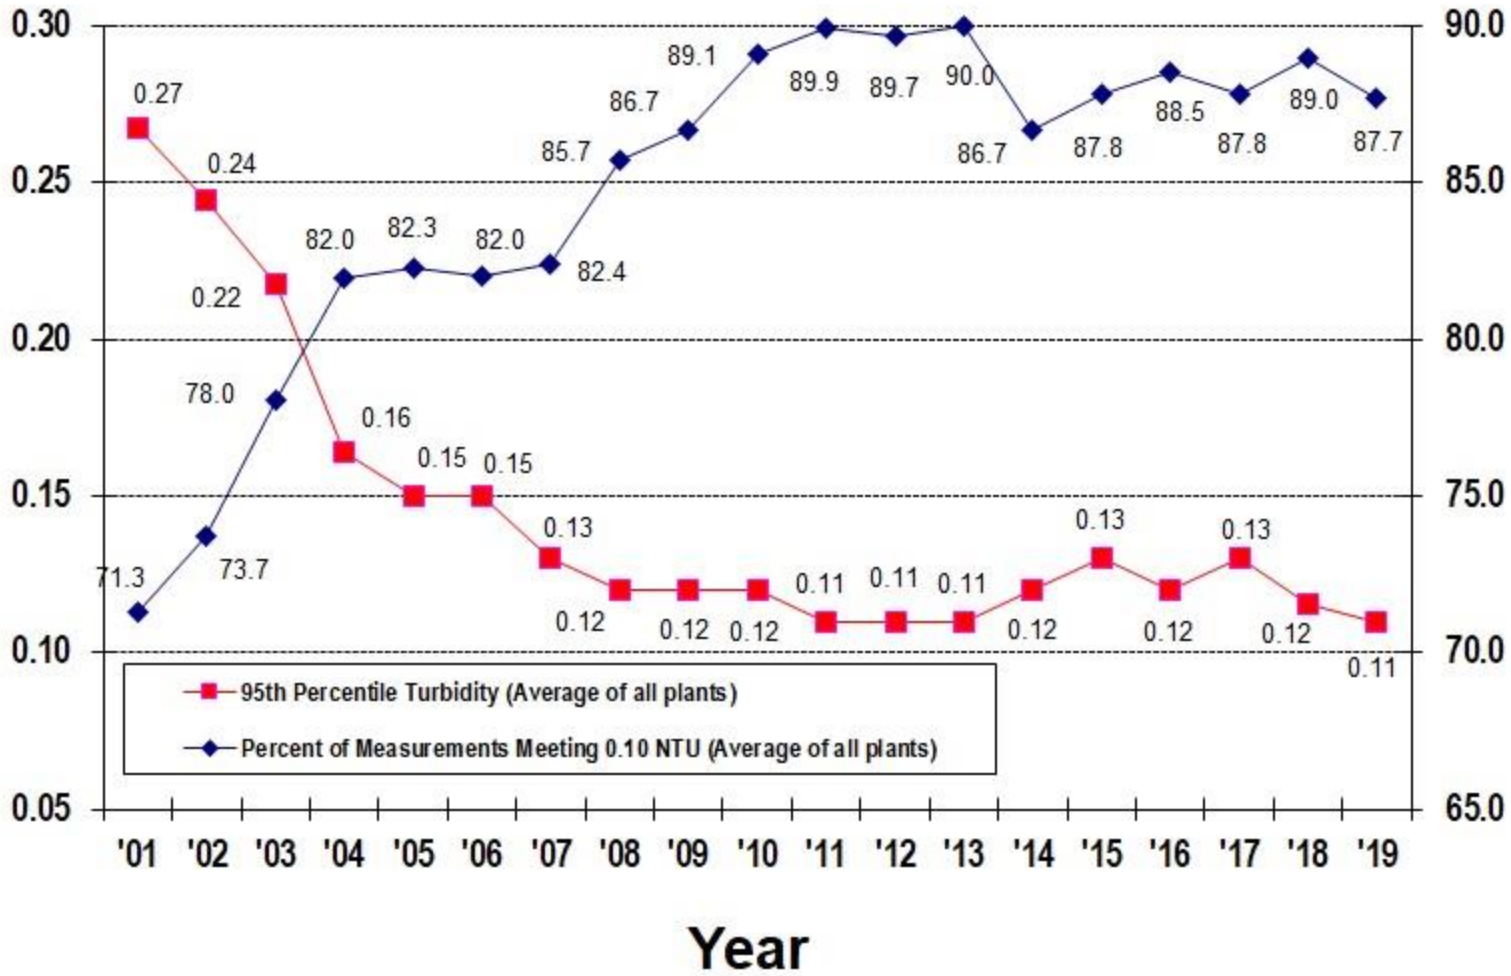

Percent of Measurements Meeting 0.10 NTU

NTU95 vs Population Served

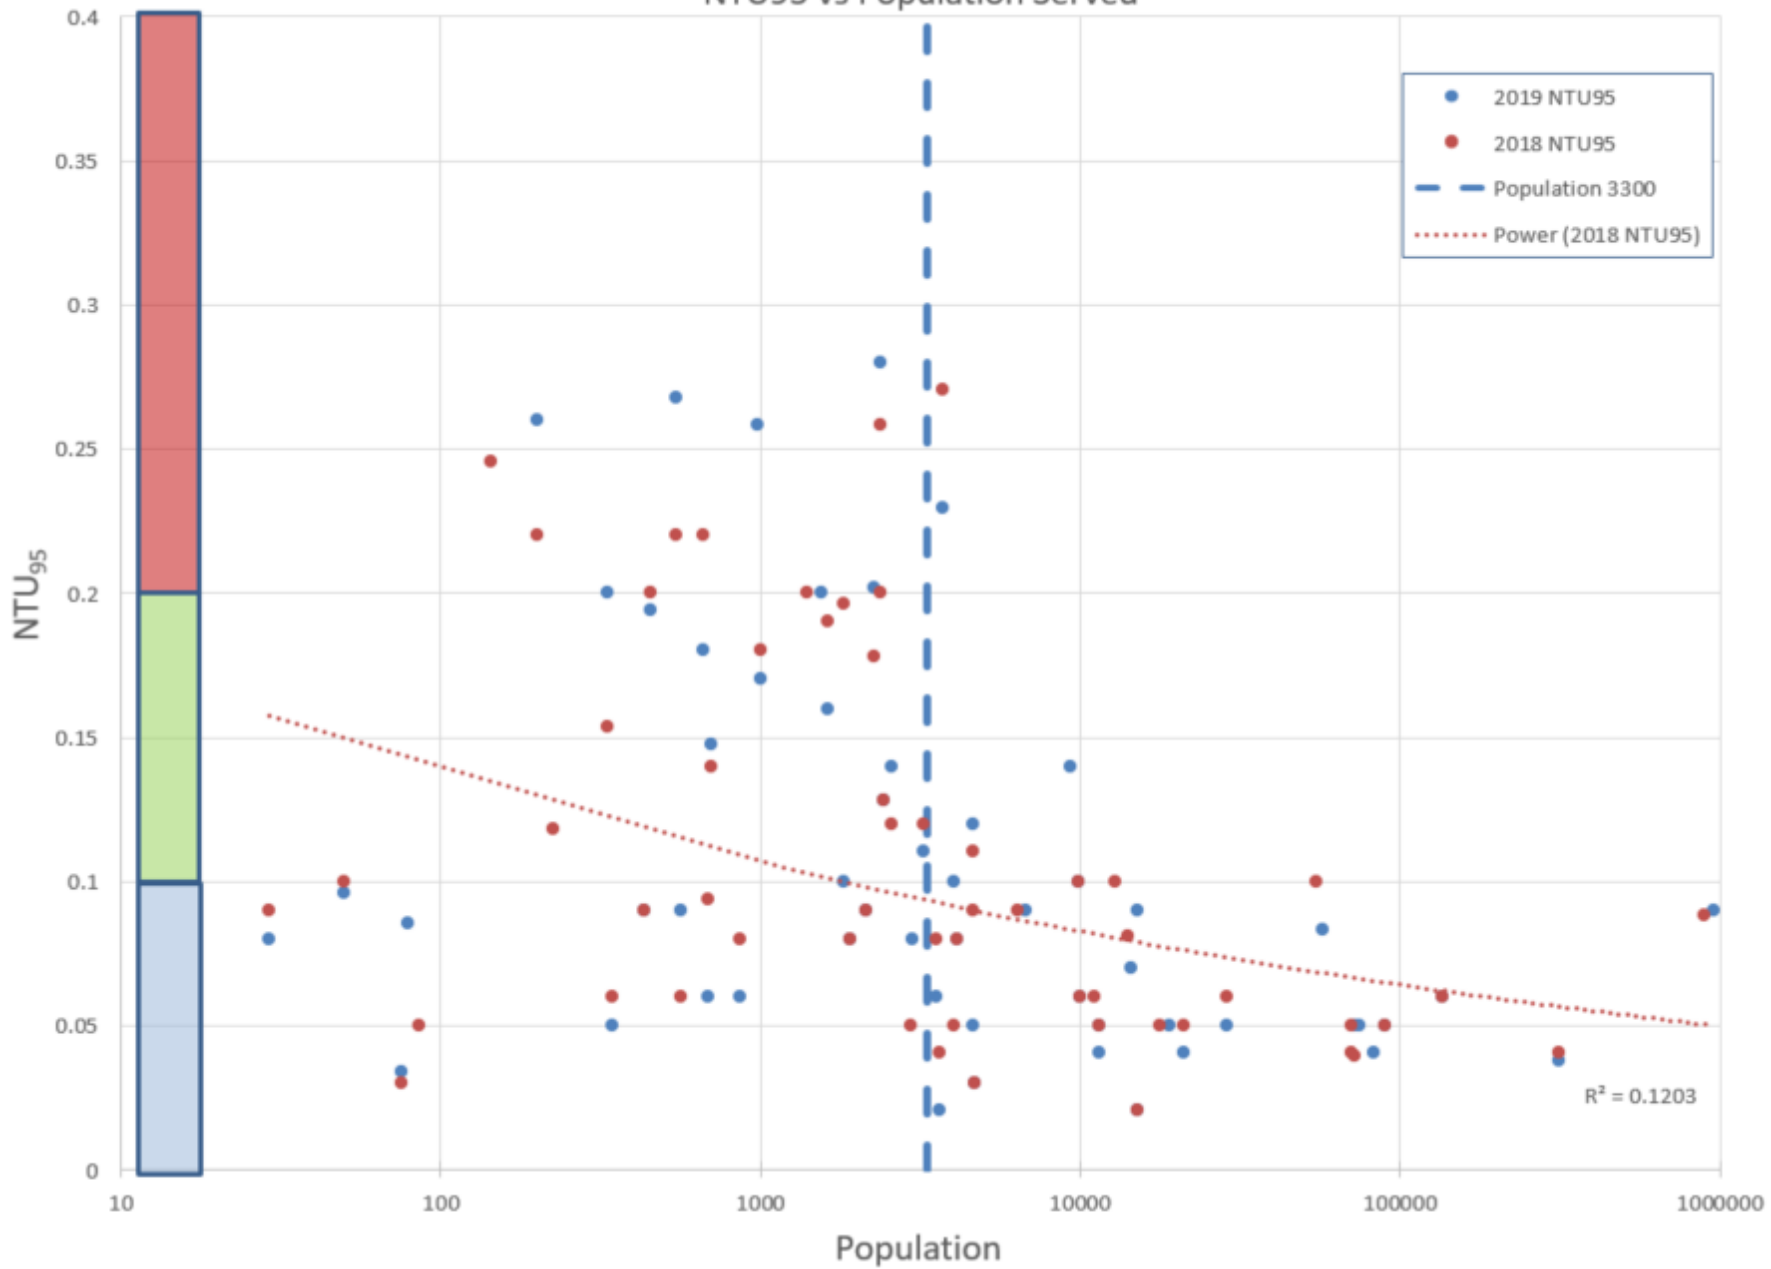



Team Members

<input type="checkbox"/>	First Name	Last Name	Business Phone	Email Address	Job Title for SWT
<input type="checkbox"/>	Stephen	Baker	360-236-3138	stephen.baker@doh.wa.gov	Water Treatment Specialist (Operations)
<input type="checkbox"/>	Nancy	Feagin	253-395-6765	nancy.feagin@doh.wa.gov	Surface Water Team Lead
<input type="checkbox"/>	Nick	Fitzgerald	360-236-3037	Nick.Fitzgerald@doh.wa.gov	Southwest Regional Office Surface Water Lead
<input type="checkbox"/>	Jolyn	Leslie	253-395-6762	jolyn.leslie@doh.wa.gov	Northwest Regional Office Surface Water Lead
<input type="checkbox"/>	Russell	Mau	509-329-2116	russell.mau@doh.wa.gov	Eastern Regional Office Surface Water Lead
<input type="checkbox"/>	Sam	Perry	253-395-6755	sam.perry@doh.wa.gov	Management Sponsor/Water Treatment Engineer (Design)